



# Fire Flow Availability and New Service Connection Process

## A - Single Family Residential/Commercial/Industrial/Multifamily Properties, System Improvements and RPDA Not Required

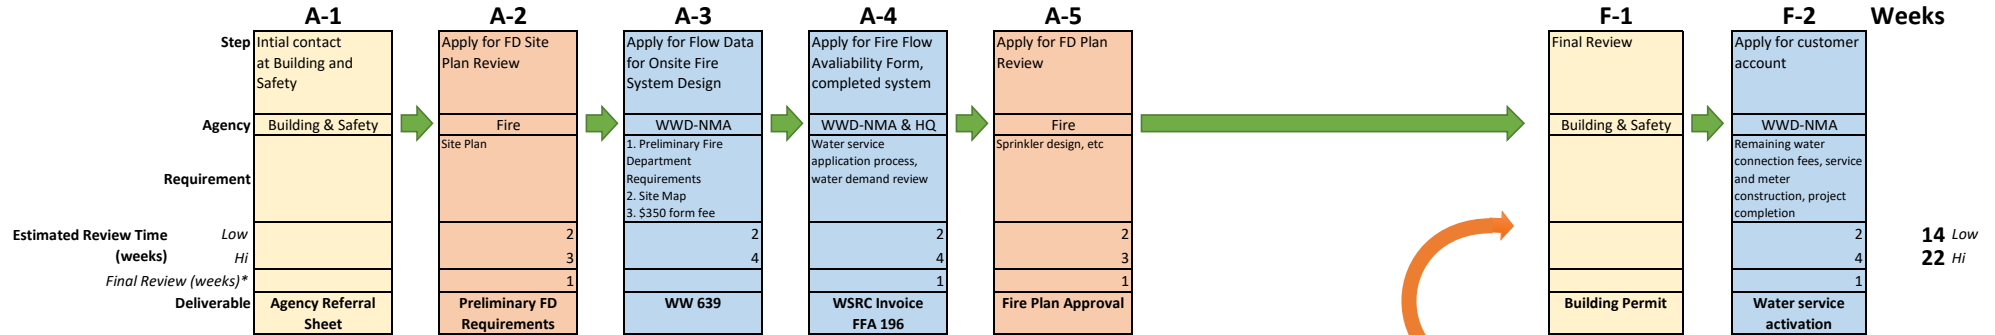

## B - Tracts/Commercial/Industrial/Multifamily Properties, System Improvements Required (Fire Hydrants, Water Main, etc.)

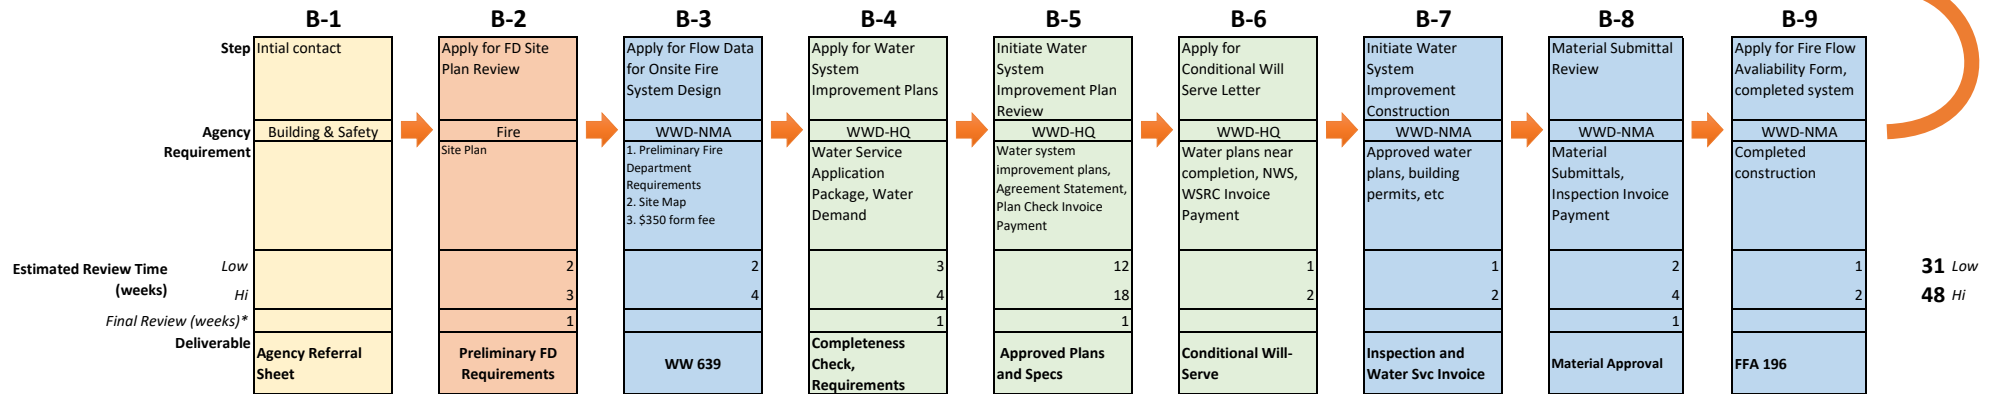

\*Final review counts time needed to complete the final deliverable after all required documents are received and reviewed.

Reviewing Agency	Phone number	Address
LA County Fire	(661) 949-6319	335-A E Avenue K-6 Lancaster, CA 93535
WWD-NMA: Lancaster	(661) 940-9270	260 E Avenue K-8 Lancaster, CA 93535
WWD-HQ: Alhambra	(626) 300-4681	1000 S Fremont Ave Building A9-E, 4th Floor Alhambra, CA 91803
City of Lancaster B&S	(661) 723-6144	44933 Fern Av, Lancaster, CA 93534
City of Palmdale B&S	(661) 524-2390	38250 Sierra Hwy, Palmdale, CA 93550
Antelope Valley B & S	(661) 267-5353	335 E Ave K-6 #A, Lancaster, CA 93535
City of Malibu B & S	(310) 456-2489	23825 Stuart Ranch Rd, Malibu, CA 90265
Calabasas/Westlake Village B&S	(818) 880-4150	26600 Agoura Rd Unit 110 Calabasas, CA 91302

Estimated review times are given a time in weeks. Review times may vary. A low estimate is given for the best case turnaround, and the hi estimate is in the case of a longer turnaround time.